


ADULT

MDR-TB MONITORING AND MANAGEMENT FLOWCHART

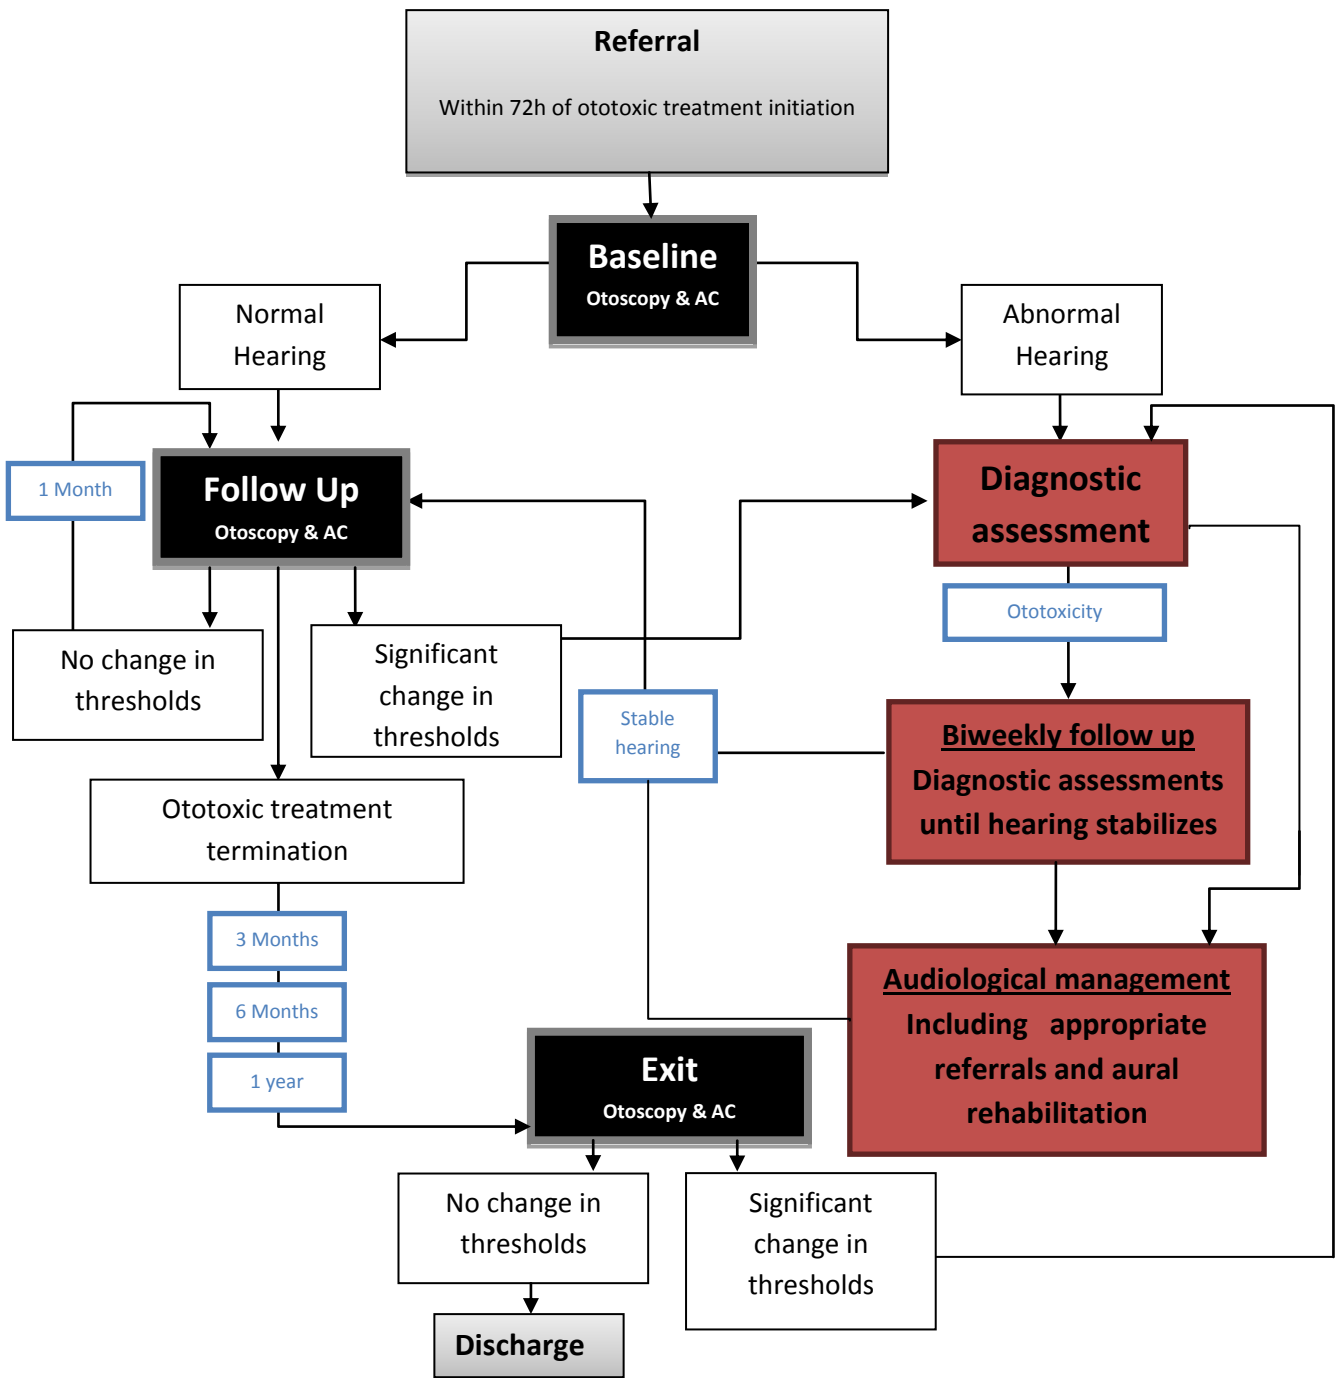


- Can be performed by screener under audiologist supervision (Otoscopy and Air Conduction Threshold screening - AC)
- Function performed by audiologist

Implementation subject to availability and access to appropriate staff and equipment.

ADULT

MDR-TB OTOTOXICITY MONITORING AND MANAGEMENT FLOWCHART

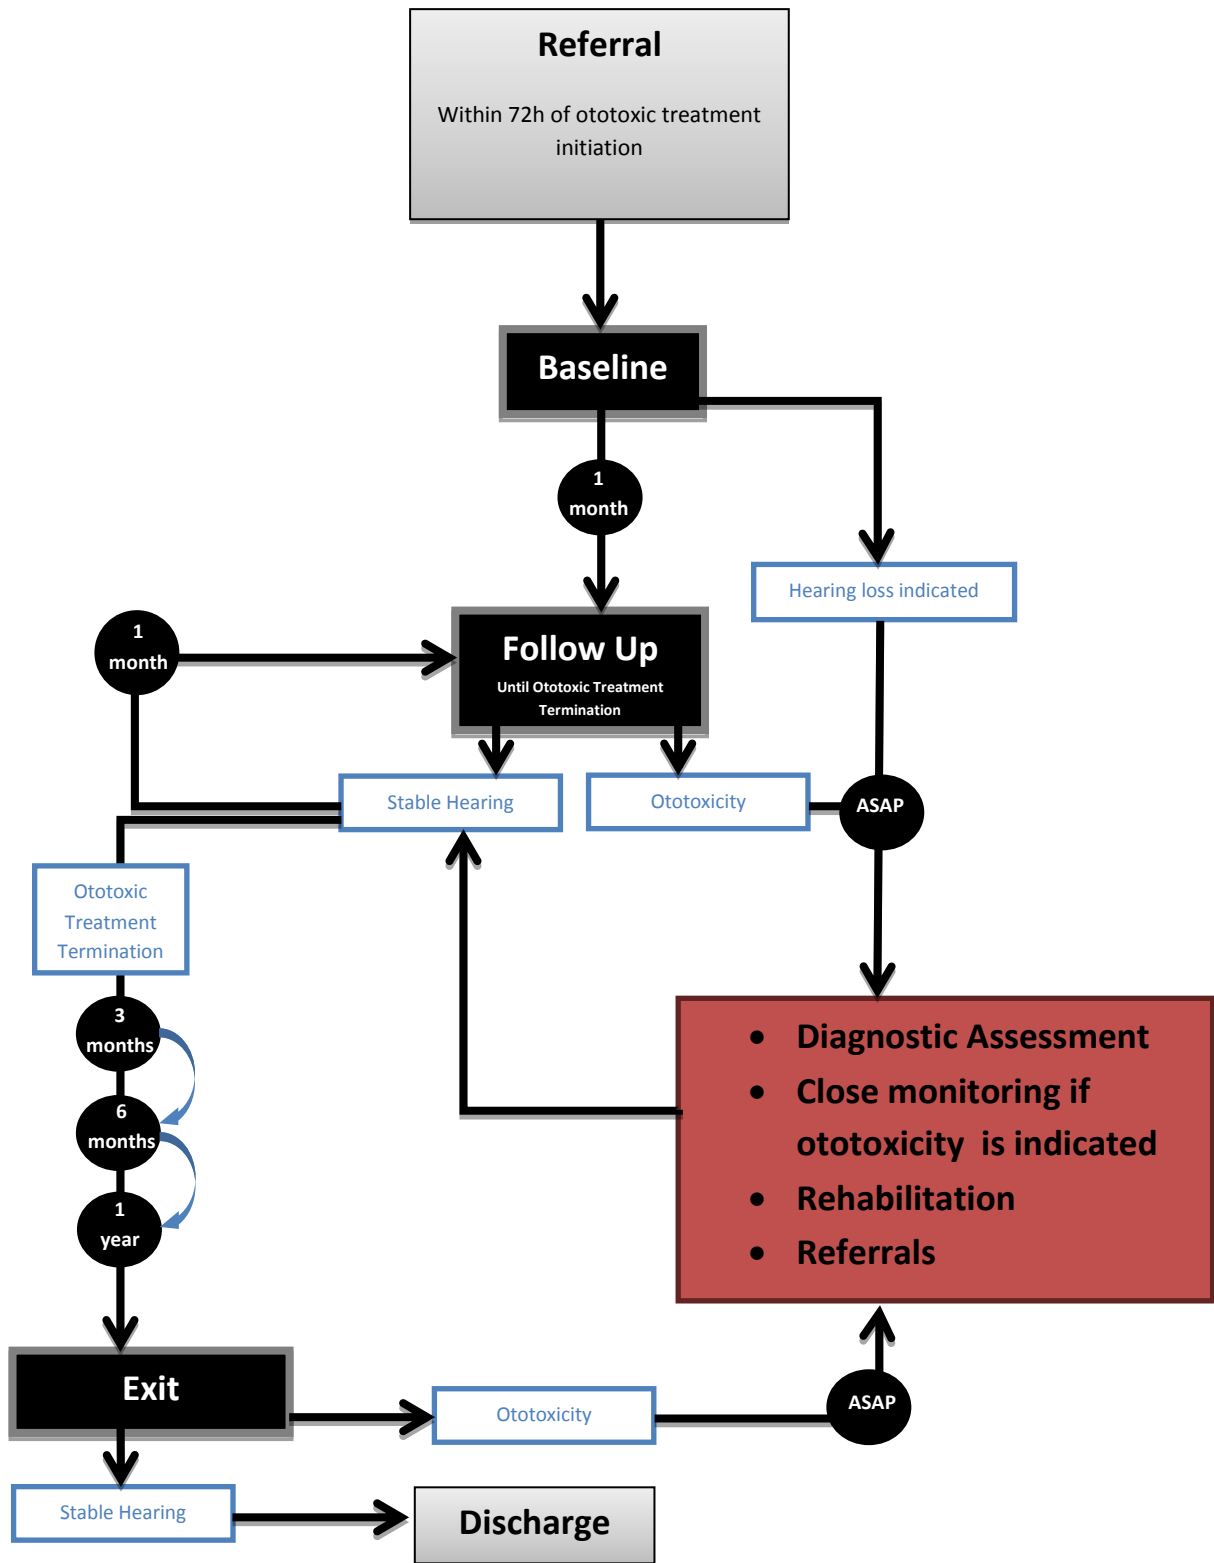

- Can be performed by screener under audiologist supervision
- Function performed by audiologist

Implementation subject to availability and access to appropriate staff and equipment.